


HHDrawings\L1\L14103-Dwg-202006-2:25:09-PM

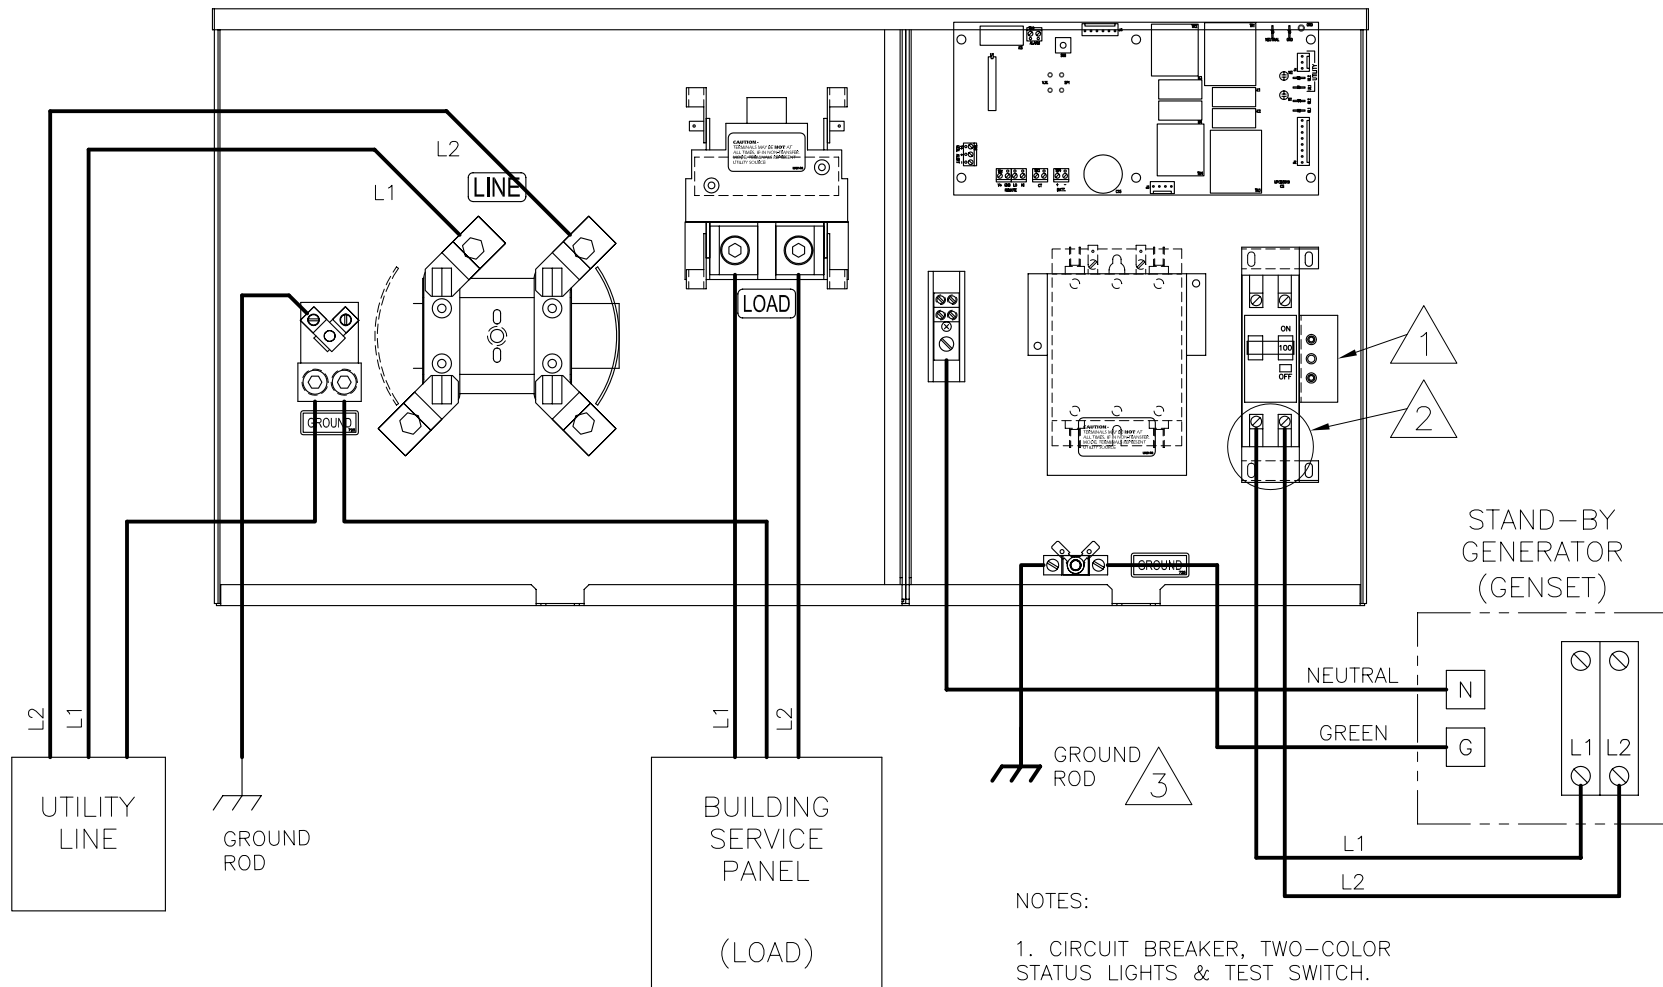

NOTES:

1. CIRCUIT BREAKER, TWO-COLOR STATUS LIGHTS & TEST SWITCH.
2. GENERATOR HOOKUP AT CB.
3. (8AWG, MIN) COPPER GROUND WIRE MUST BE CONNECTED TO SERVICE/UTILITY GROUND ROD.

Rev.D 02-03-05: Updated per markup and LW149 rev.B.

PROPRIETARY AND CONFIDENTIAL NOTE: THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF ELECTRO INDUSTRIES INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF ELECTRO INDUSTRIES INC. IS PROHIBITED.	DESCRIPTION ELECTRO GENCONNECT (LG/TC)-100M2MO HOOKUP	ELECTRO INDUSTRIES, INC. MONTICELLO, MN 55362	SHEET 1/1	SCALE 1:5	PART/MODEL NUMBER ** - 100M2MO
		DRAWN MEF	CHECKED	APPROVED	DATE 02-03-05