


HHDrawings\L1\L14106-GenWg-202005-2:55:56 PM

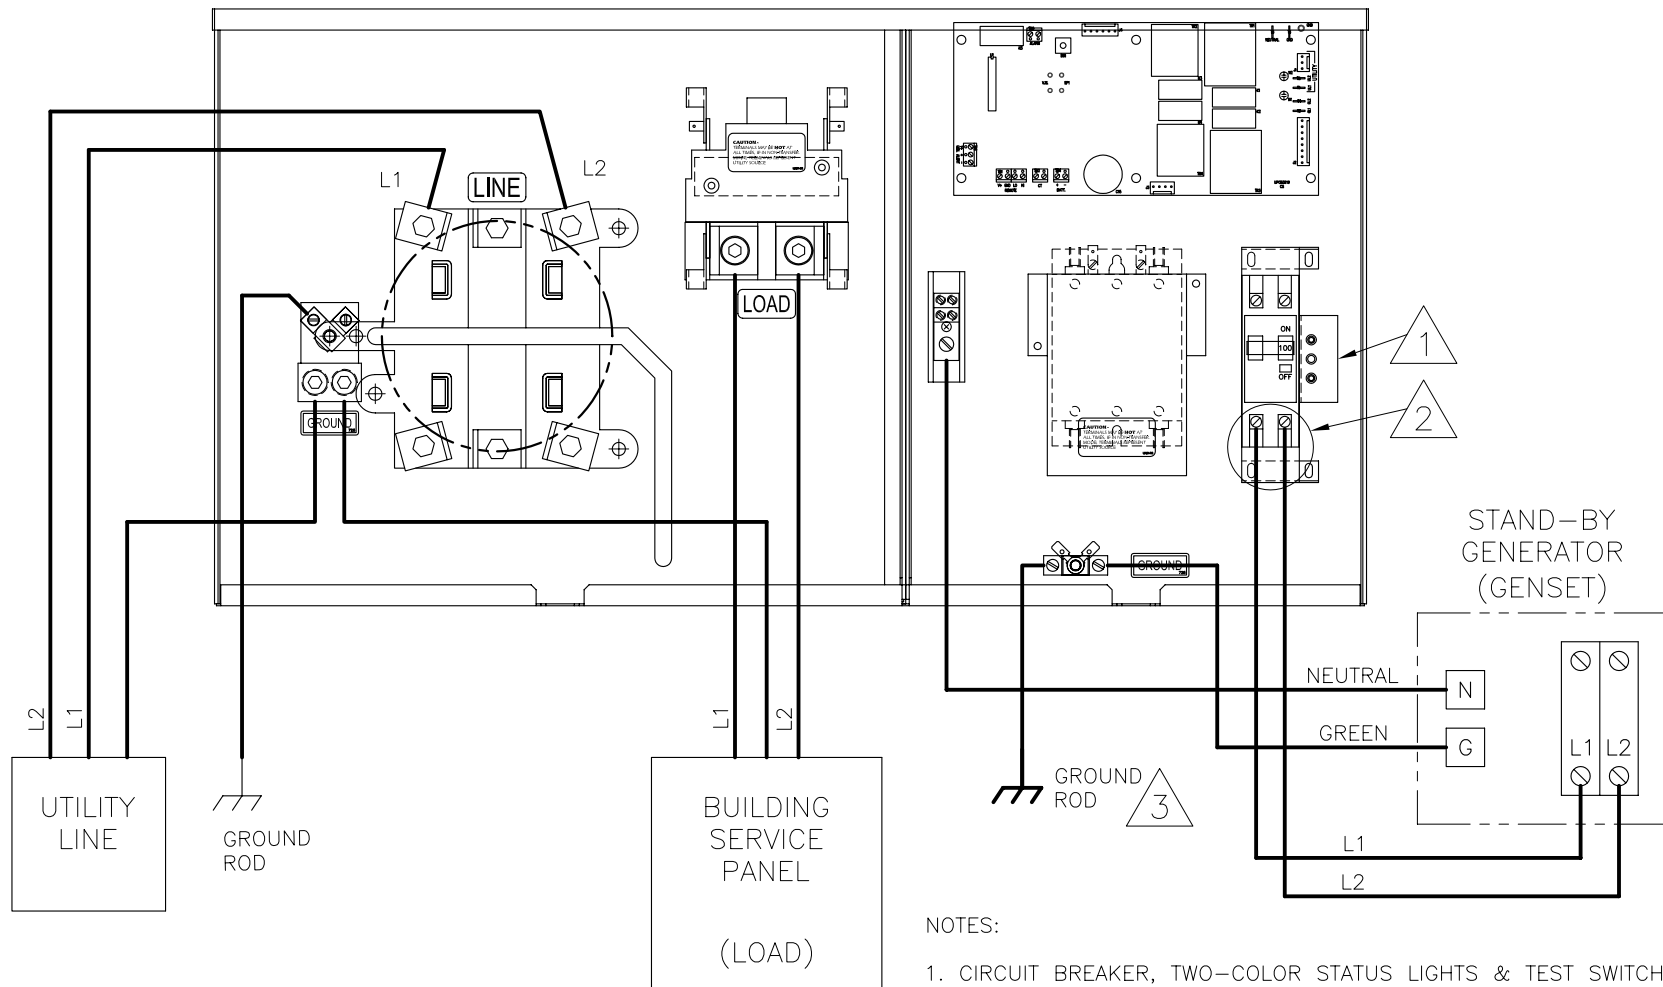

NOTES:

1. CIRCUIT BREAKER, TWO-COLOR STATUS LIGHTS & TEST SWITCH.
2. GENERATOR HOOKUP AT CB.
3. (8AWG, MIN) COPPER GROUND WIRE MUST BE CONNECTED TO SERVICE/UTILITY GROUND ROD.

Rev.C 02-03-05: Updated per markup and LW149 rev.B.

PROPRIETARY AND CONFIDENTIAL NOTE: THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF ELECTRO INDUSTRIES INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF ELECTRO INDUSTRIES INC. IS PROHIBITED.	DESCRIPTION ELECTRO GENCONNECT (LG/TC)-100M2H0 HOOKUP	ELECTRO INDUSTRIES, INC. MONTICELLO, MN 55362	SHEET	SCALE	PART/MODEL NUMBER		
			1/1	1:5	** - 100M2H0		
		DRAWN	CHECKED	APPROVED	DATE	REV/STATUS	DOCUMENT NUMBER
		MEF			02-03-05	C	LH106